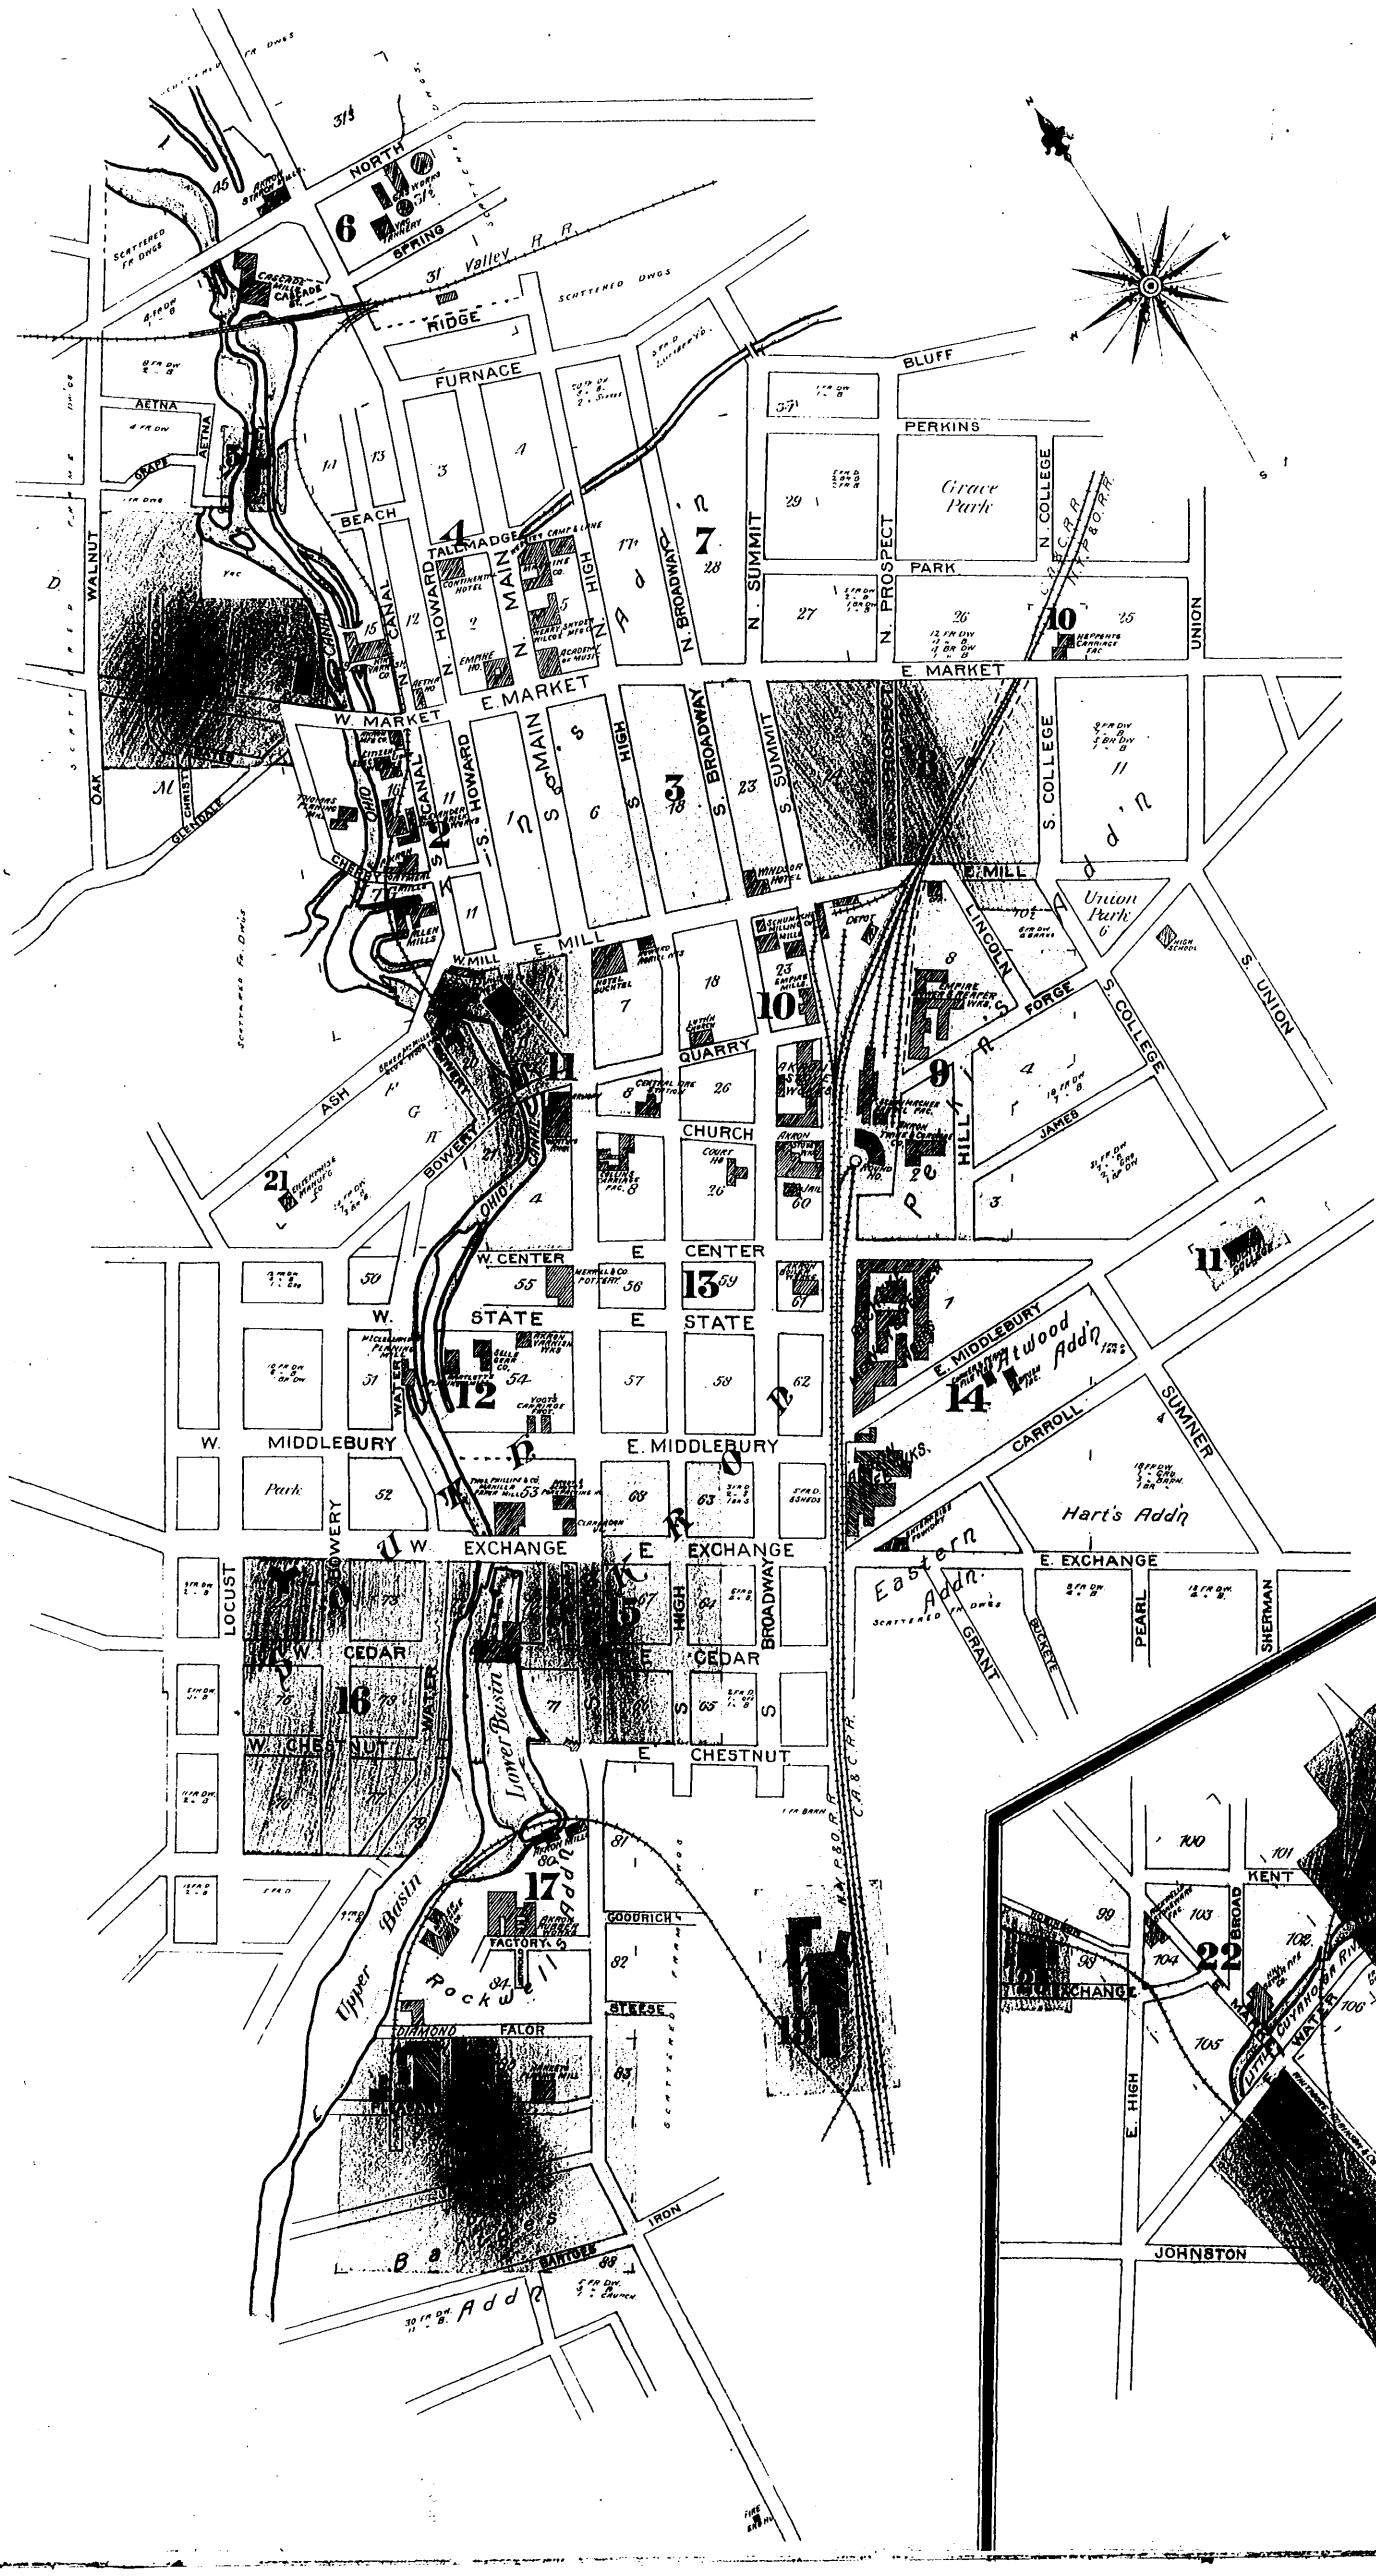

16 SHEETS. **1**

SEP. 1886
AKRON
OHIO

POPULATION 25,000
Prevailing Winds
SO. WEST.

WATER FACILITIES Water Works Reservoir, Capacity 5 Million Galls, 200' above business portion of city. 25 miles of Pipe laid, 176 Double Hydrants. Brick Pump Ho. about 2 Miles S.W. of P.O. 2 Worthington Pumps, 1 Compound, Capcy 7 Million Galls per day, & 1 Compound Duplex Capcy 12 Million Galls per day. Pressure Varies from 25 to 100 lbs per Sq. Inch. Canal & Race through business portion of City. Public Cisterns in Dwelling Part.

FIRE DEPARTMENT INCLUDING East Akron - Paid. Chief & Assistant, 2 Engineers, 2 Fire-men, 6 Drivers, 1 Tillerman, 4 Pipe men, 23 Call Hose men, 14 Call ladder men, 6 Call Steamer men. 2 Steam Silsby Fire Engines, 5 Hose Carts, 1 Hook & Ladder Truck. About 1500' of White Anchor Hose in good condition.

Ground Heights are Calculated from New Datum 245' below monument in Court House Yard, see Sheet No. 13.

Akron, Ohio.
September, 1886.

We, the Insurance Agents of Akron, Ohio, having examined the Sanborn Insurance Map of our City, made Aug-t-Sept. 1886, certify the same to be the **MOST COMPLETE AND ACCURATE** Insurance Map ever issued of our city, and we strongly recommend its use **AND NO OTHER.**

E. L. Donahue
President of Underwriters Ass'n
S. E. Sanford
Secretary of Underwriters Ass'n
Wm. T. Evans
John Meyrose
Frank L. Bellows
N. B. Matthews
Metz Bros
R. S. Insell
Isaac A. Gibbons
Wilcox & Noah
Dawson & Hart
Jno. H. Noble
Philip P. Bock
H. B. Hitchcock

EAST AKRON

FIRE DEPARTMENT
— Paid —
5 Men. 8 Minute Men 1-3d Class Silsby Engine, 1 Hose Cart. 900' 2½" Hose, 3 Horses. Telegraphic Fire Alarm and Telephone connections.

Map Division
Jul 29 '55
Library of Congress