



ALL PARTS OF BLDG INCLUDING PORTION OVER ALLEY EQUIPPED
WITH NARROW AUTO SPRINKLERS-HEADS SPACED 8 X 10
FEET SYSTEM SUPPLIED BY DIRECT CITY PRESSURE
ABOUT 100 TO 125 LBS. & BY 6500 GAL WOOD GRAVITY
TANK ELEV 20' AVE. RF ON STEEL TRUSSE. TANK FILLED
FROM ONE 8" CITY CONN BY ELECTRIC PUMP-AUX SIAMISE
STR CONN NO WATCHMAN HEAT STEAM FUEL COIL
LIGHTS-ELECTRIC EP


55 TO 65 S HOWARD ST INC & 1ST FL OF 54 S MAIN ST
NIGHT WATCHMAN, NO CLOCK, HEAT: STERN, LIGHTS: ELECTRIC.
OUTSIDE: CURRENT GAS IN EMERGENCY: FUEL: COAL.
BLDG EXCEPT 54 S MAIN ST, EQUIPPED WITH NINGRRA ROTO
SPRINKLERS, SPACED 9' X 10', HEAT SYSTEM EXCEPT SHOW
WINDOWS & BACK STAIR SHAFT WHICH ARE DRY. SUPPLIED
BY DIRECT CITY PRESSURE 100 TO 125 LBS AND 91 3000 GAL.
PRESSURE TANK ON 1ST FL FILLED BY ELECTRIC PUMP FROM
DME & CITY CONC. RUM SIEMENSE STR CONC.

THE AKRON DRY GOODS CO
19 S HONARD ST - 18 20 & 22 S MAIN ST

8 S HONARD ST IS FIRE PROOF CONSUMT BUILT ON
CONCRETE STEEL FRAME. BERGAR SYSTEM OF CEILING
CONCRETE FLO 4' OF DRYK MATS. EQUIPPED WITH
VULCANIZED RUBBER SHOOTERS BUT NOT FIRE SYSTEM
TRUNKS SPACED 8" X 10" FILLED BY ASIO GUM PRESSURE
HARD IN TILL BLOB 6" IN. FILLED BY ELECTRIC PUMP FROM
A CONN TO CITY MAINLINE. IS 185 PRESSURE ON HELL
RUB. STAIRCASE 375 CON.
8 20 & 22 S MAIN ST TO BE SPANNIKER. NO WATER.

37 1ST & 5TH FLS OF 26 TO 32 S MAIN ST. ALL OF 47 SPDS INCL S MAIN ST.
R 6TH & 6TH FLS OF 54 S MAIN ST. ALL OF 49 INCL S MAIN ST.
NIGHT WATCHMAN - AMERICAN WATCHMAN'S TIME DETECTION - 11:15 P.M.
HOURLY REPORTS - ALSO REPORTS HOURLY FROM 11:15 P.M.
STERN - LIGHTS - ELECTRIC - BOTH OUTSIDE - CURRENT & 1 EP 25 S
EMERGENCY - POWER - GAS ENGINES - FUEL - CO - 10 25 S & 4TH FLS 3F
S MAIN ST. - BLDGS R 4TH & 5TH FLS 3F - 4TH FLS RESPECTIVELY
OF S MAIN ST. - BLDGS - ALL BLDGS EXCEPT 25 S MAIN ST. & 4TH
WITH NINGRA BOW TOP SPRINKLERS & FEW HERCHER & HIBBARD
HEADS - HEADS SPACED 8' X 10' - 8TH SYSTEM EXCEPT SHOWN WINDINGS & R
DIP SUPPLIED BY 200 GPM PRESSURE 100 FTS OF 25 S MAIN ST. 3000 GPM PRESSURE TANK R
25 S MAIN ST. - 25 S MAIN ST. - 25 S MAIN ST. - 25 S MAIN ST. - 25 S MAIN ST. - 25 S
OF 30 S MAIN ST. ON BRICK ELEVATOR WALLS. GRAVITY TANK FILLED
PRESSURE TANKS WHICH ARE FILLED FROM CITY MAINS BY ELECTRIC PUMP
THAT 4 S & ONE 6 CITY CUMS. DIRECT CITY PRESSURE 20 TO 25 PS.
TANKS USED FOR ANNUNCIATIONS & SUPERVISORY SERVICE
2 THREE GAL. CUMS.

56 TO 70 INCL 5 MAIN ST
NIGHT & SUNDAY WATCHMAN NO CLOCK HEAT STEAM
LIGHTS: ELECTRIC GAS IN EMERGENCY FUEL COAL
70 BLDGS EQUIPPED WITH NIAGARA AUTO SPRINKLERS
FLOORS SPACED 8 X 10' NET SYSTEM EXCEPT SNOW
WINDOWS WHICH ARE OIL SUPPLIED BY 3000 GAL PRESSURE
TANK 6TH FL OF 68 S MAIN ST FILLED BY ELECTRIC
PUMP FROM CITY MAINS - ONE 5' CONN - DIRECT CITY
PRESSURE ON HEADS 100 TO 125 LBS - RUX SIEMENS ST
CONN - AUTO ANNUNCIATORS - 24 CHEMICALS DISTRIBUTED

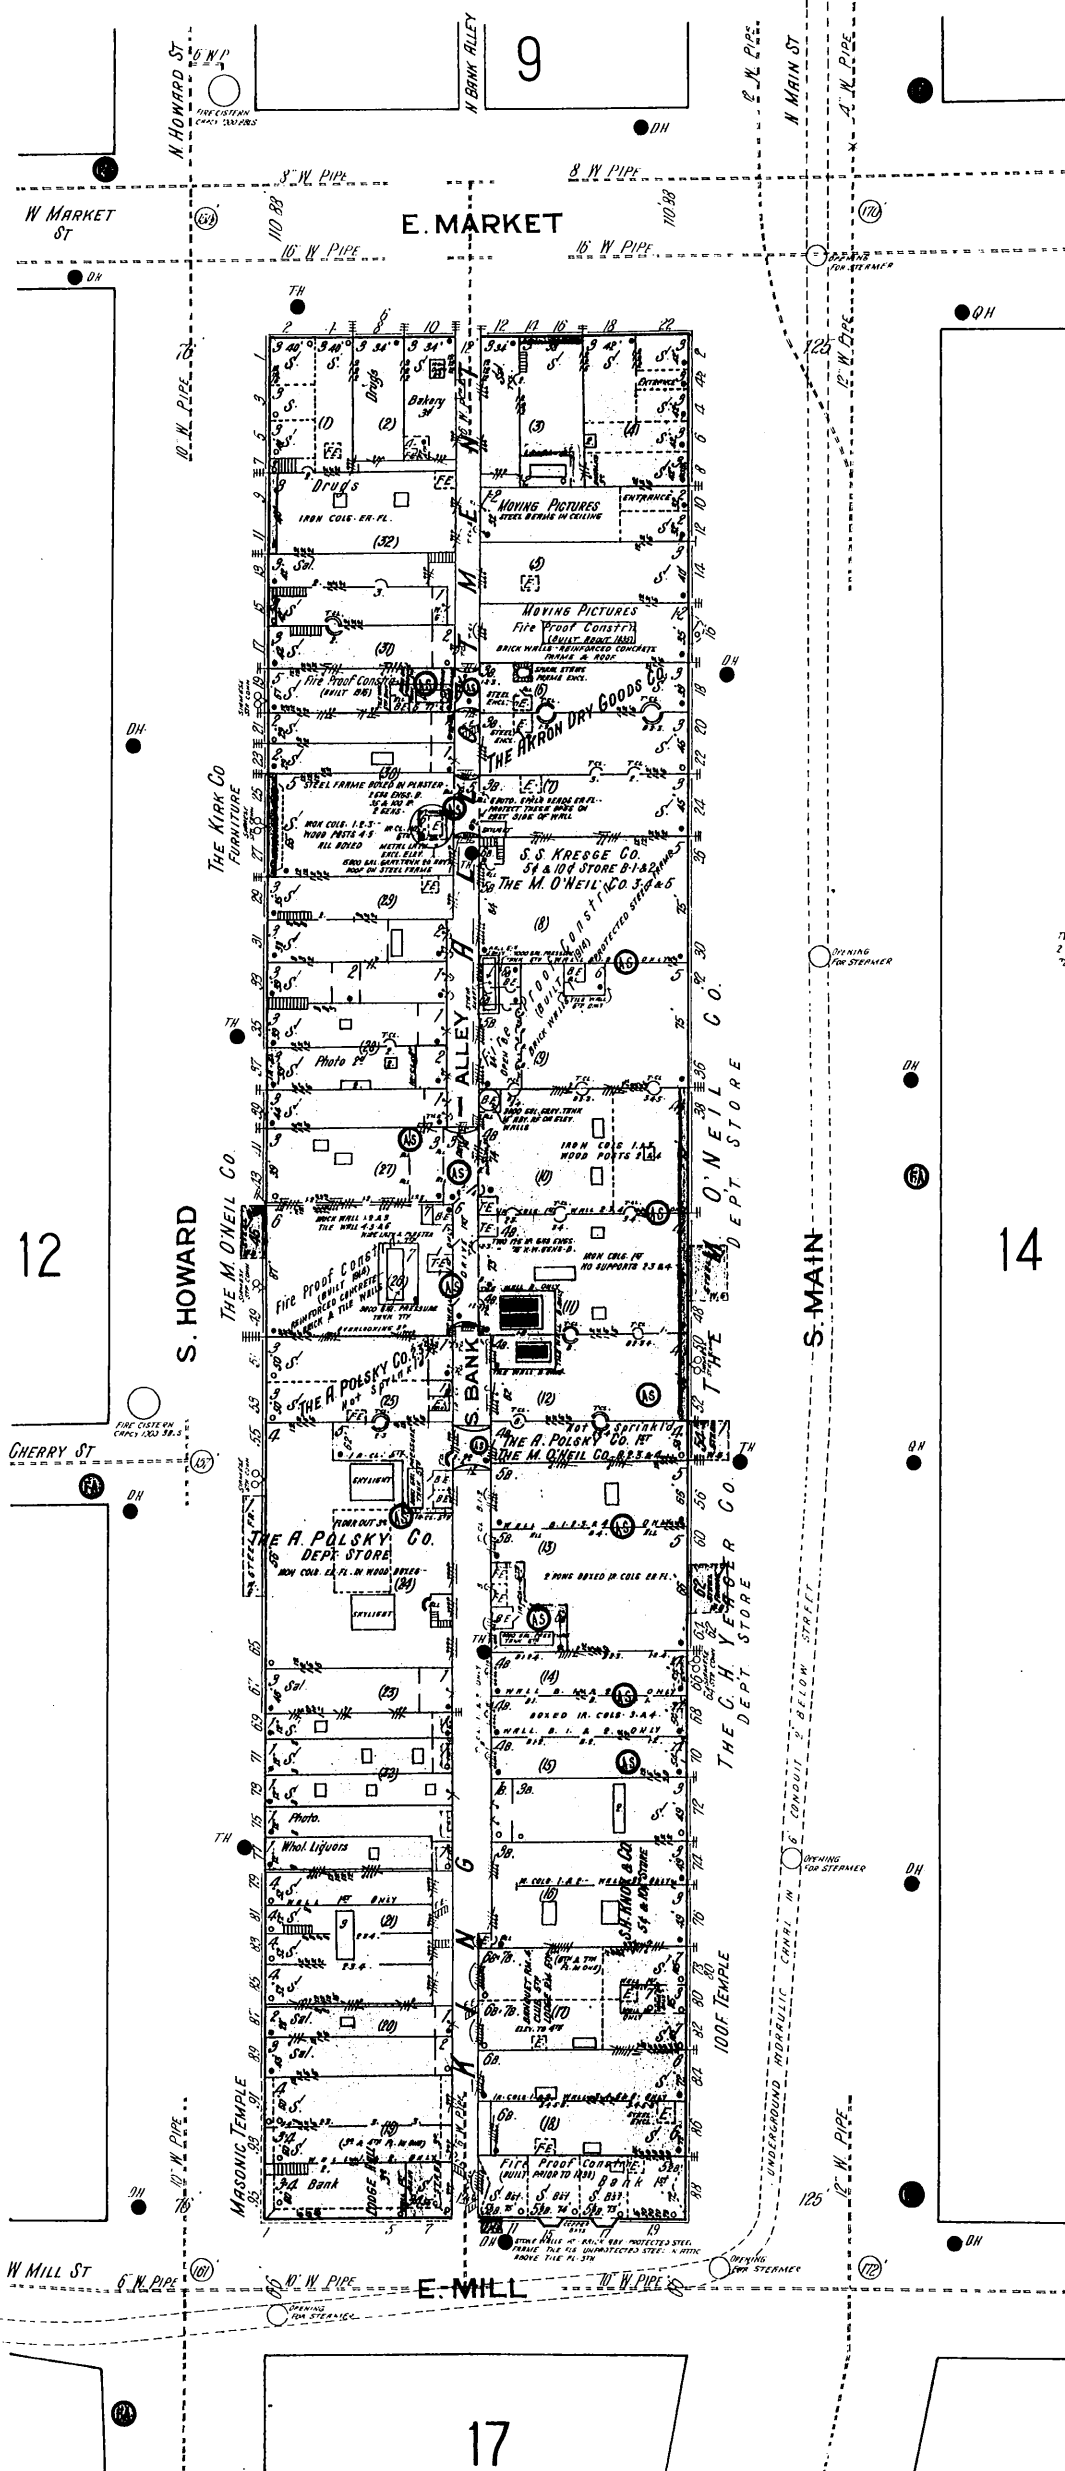

Scale of Feet.