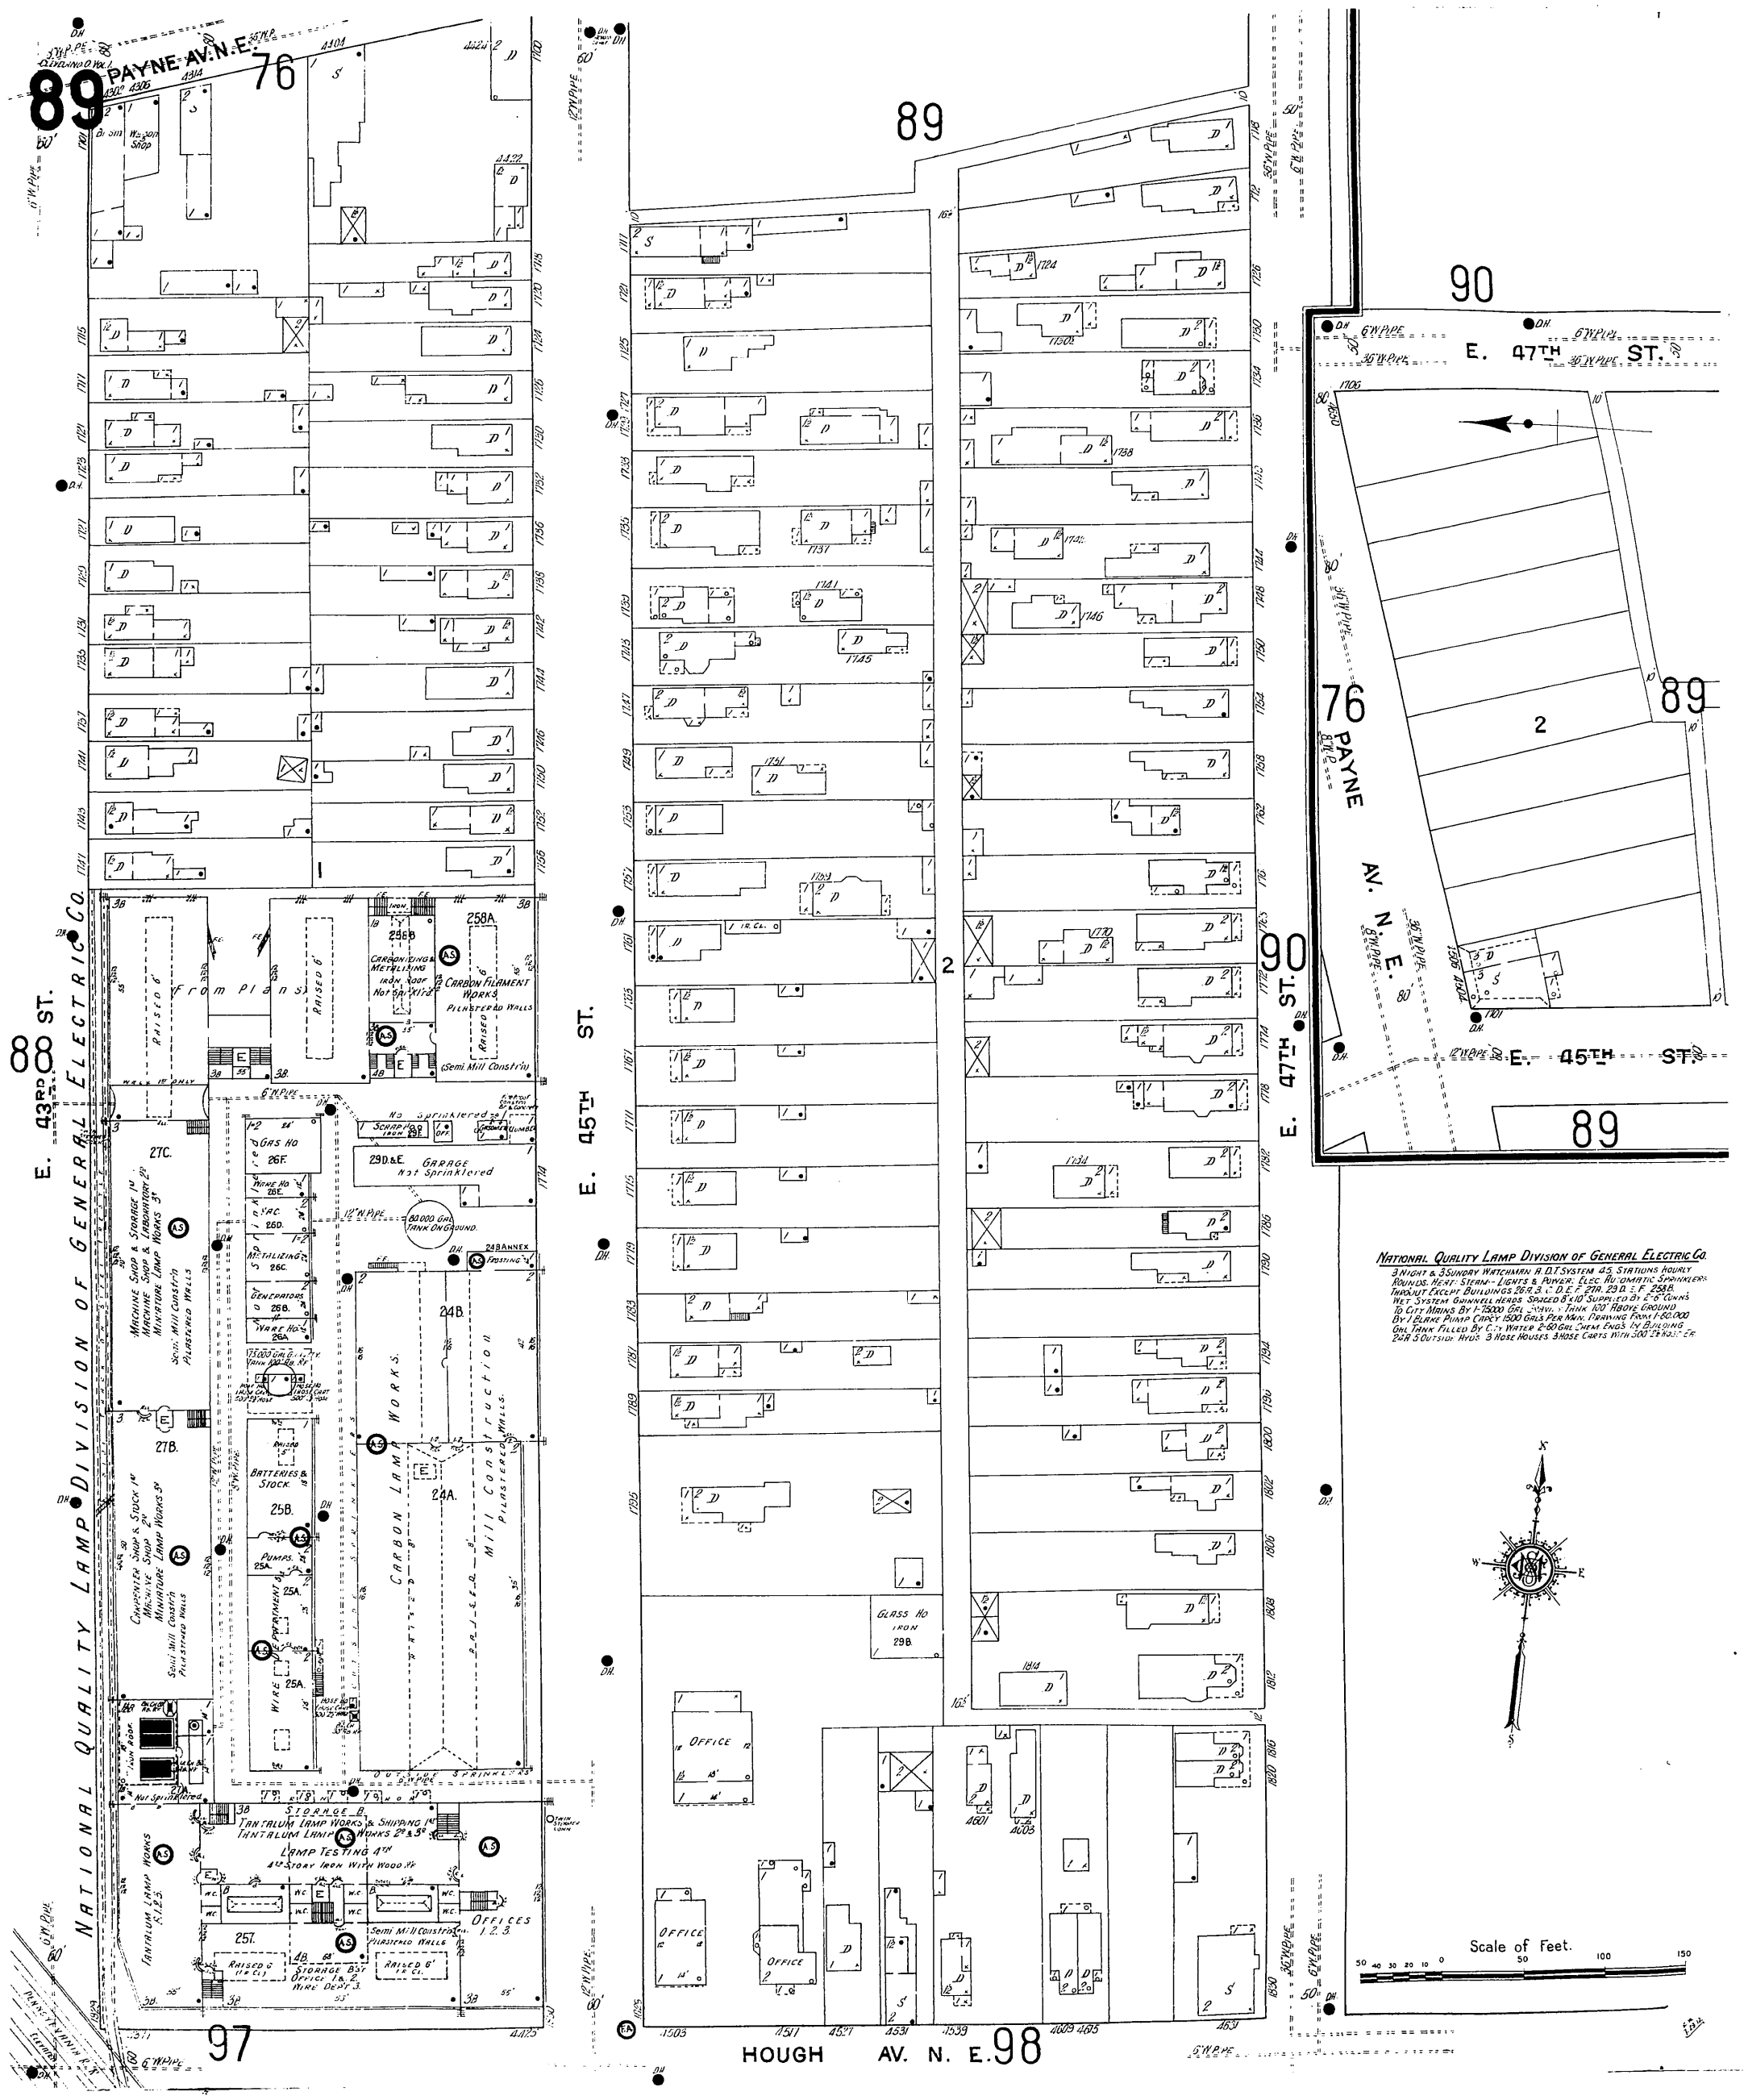

NATIONAL QUALITY LAMP DIVISION OF GENERAL ELECTRIC CO.

3 NIGHT & 3 SUNDAY WATCHMAN A.D.T. SYSTEM 45 STATIONS HOURLY ROUNDS. HEAT: STEAM - LIGHTS & POWER: ELEC. AUTOMATIC SPRINKLERS THROUGHOUT EXCEPT BUILDINGS 26 A, B, C, D, E, F, 27 A, 29 D, E, F, 25 A, B. WET SYSTEM GRINNELL HEADS SPACED 8'X10' SUPPLIED BY 6" & 8" CONNS TO CITY MAINS BY 1-75000 GAL. CISTERN - THICK 100' ABOVE GROUND BY 1 CLARK PUMP CAPCY 1500 GALS PER MIN. DRAWING FROM 1-80,000 GAL TANK FILLED BY CITY WATER 2-60 GAL CHEM. ENGS IN BUILDING 24 A & 5 OUTSIDE HYDS. 3 HOSE HOUSES 3 HOSE CARTS WITH 500 FT HOSE EA.