OH10 . 040

DAYTON, O. VOL. 3.

313

OAKWOOD

DETACHMENT FORMERLY LOCATED HERE NOW SHOWN ON SHEET 399 & 399A

OAKWOOD
Population 8000
Prevailing wind S.W. All streets paved

WATER FACILITIES:

Municipal ownership. Source 2 wells and 16" & 12" mains to city of Dayton. Gravity & direct pressure system: 2 Cayne & Blower turbine well pumps, capy 300 G.P.M. ea 1-Allis Chalmers centrifugal pump capy 225 G.P.M. 1-Northmanar centrifugal pump, capy 325 G.P.M. 3-Platt Triplex pumps, capy 300 G.P.M. ea - Booster Sta at Shrouer Rd and Acorn Dr. has 2-Platt Centrifugal pumps capy 1000 G.P.M. ea 1-Standpipe 70 high, capy 505,000 gals base elevd 70 abv Town Hall, 2 miles 3 to 12" mains, 300 Triple hydts. Average daily consumption 750,000 gals. Normal pressure at Town Hall 60 lbs

FIRE DEPARTMENT:

Equipment: 1-chief, 2-pumpers, 13-men all drive police and fire duty. Fire house equipped with 600 G.P.M. pump, 100 gal booster tk, 300 feet 3" hose, 200 feet 2" hose, 1-hose car equipped with 750 G.P.M. pump, 50 gal booster tk, 500 feet 2" hose, 500 gals foam. 1-hose chassis equipped with pump capacity with 350 G.P.M. pump, 200 gal water tank, 300 gals foam. Reserve equipment: 1-pumper, 1-hose car, 1-hose chassis, 1-roofing ladder

Insurance limit of hydrants according to Schedule A.
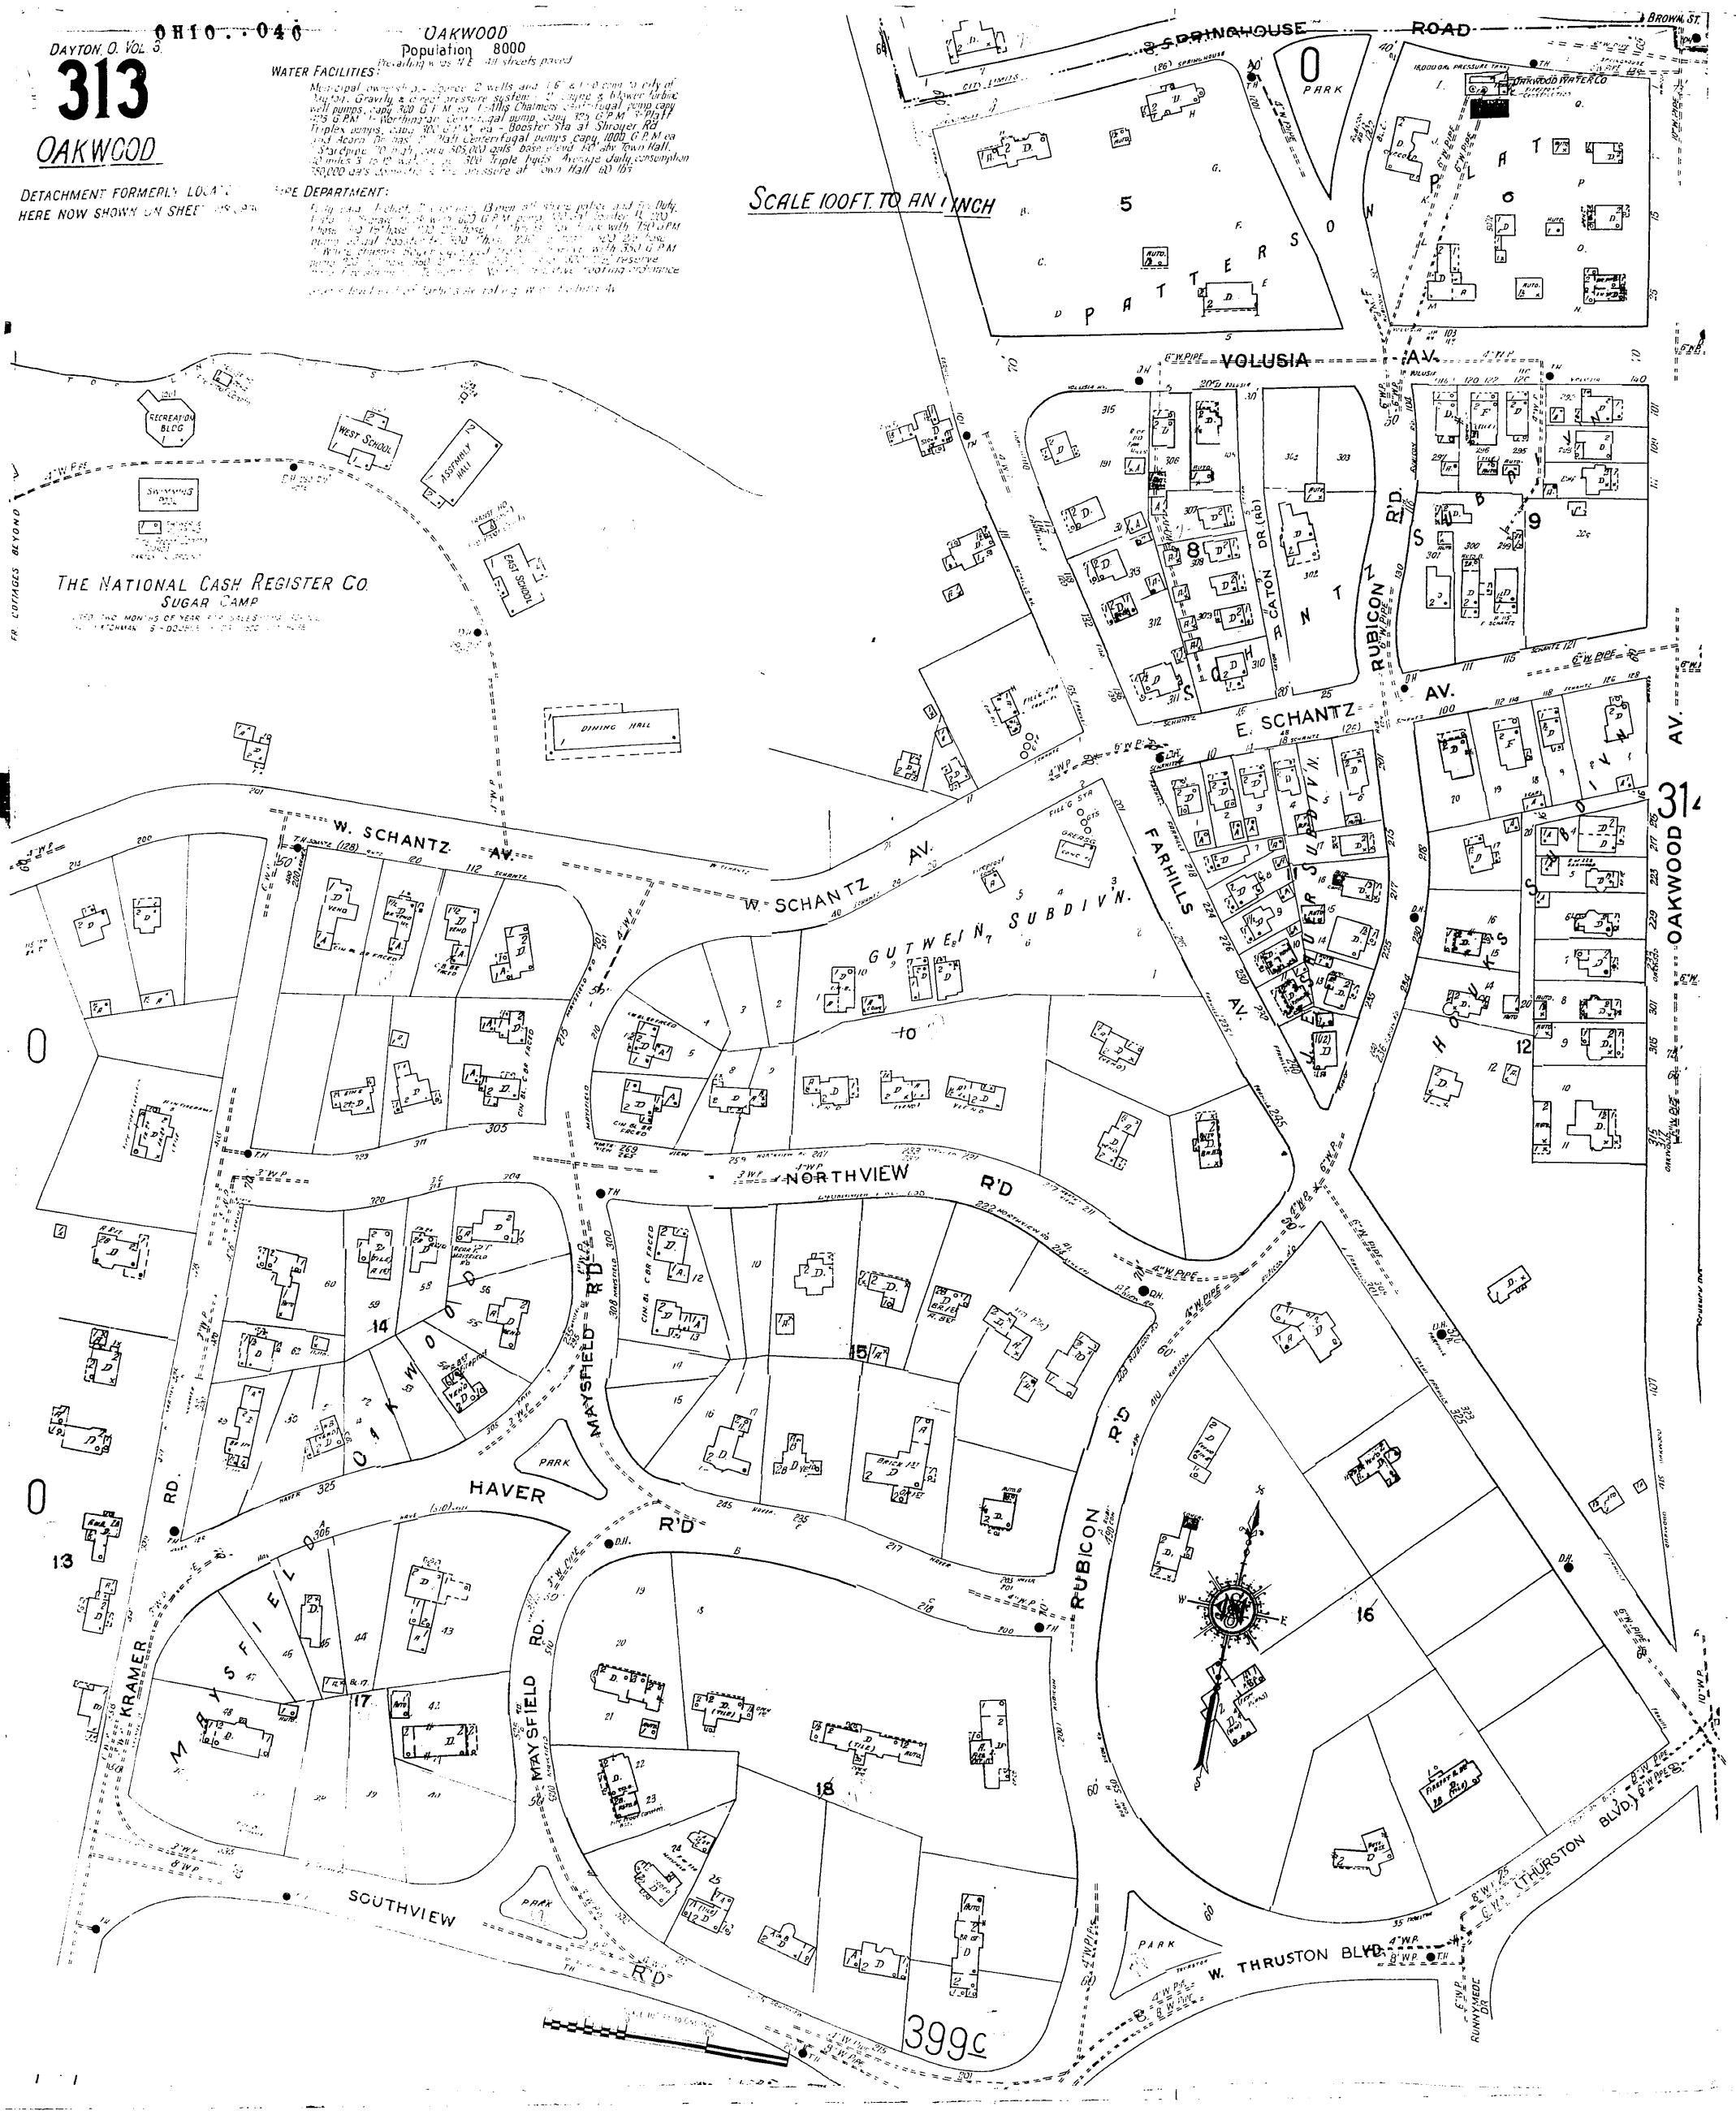
SCALE 100FT. TO AN INCH