


JUNE 1930
SHELBY
OHIO

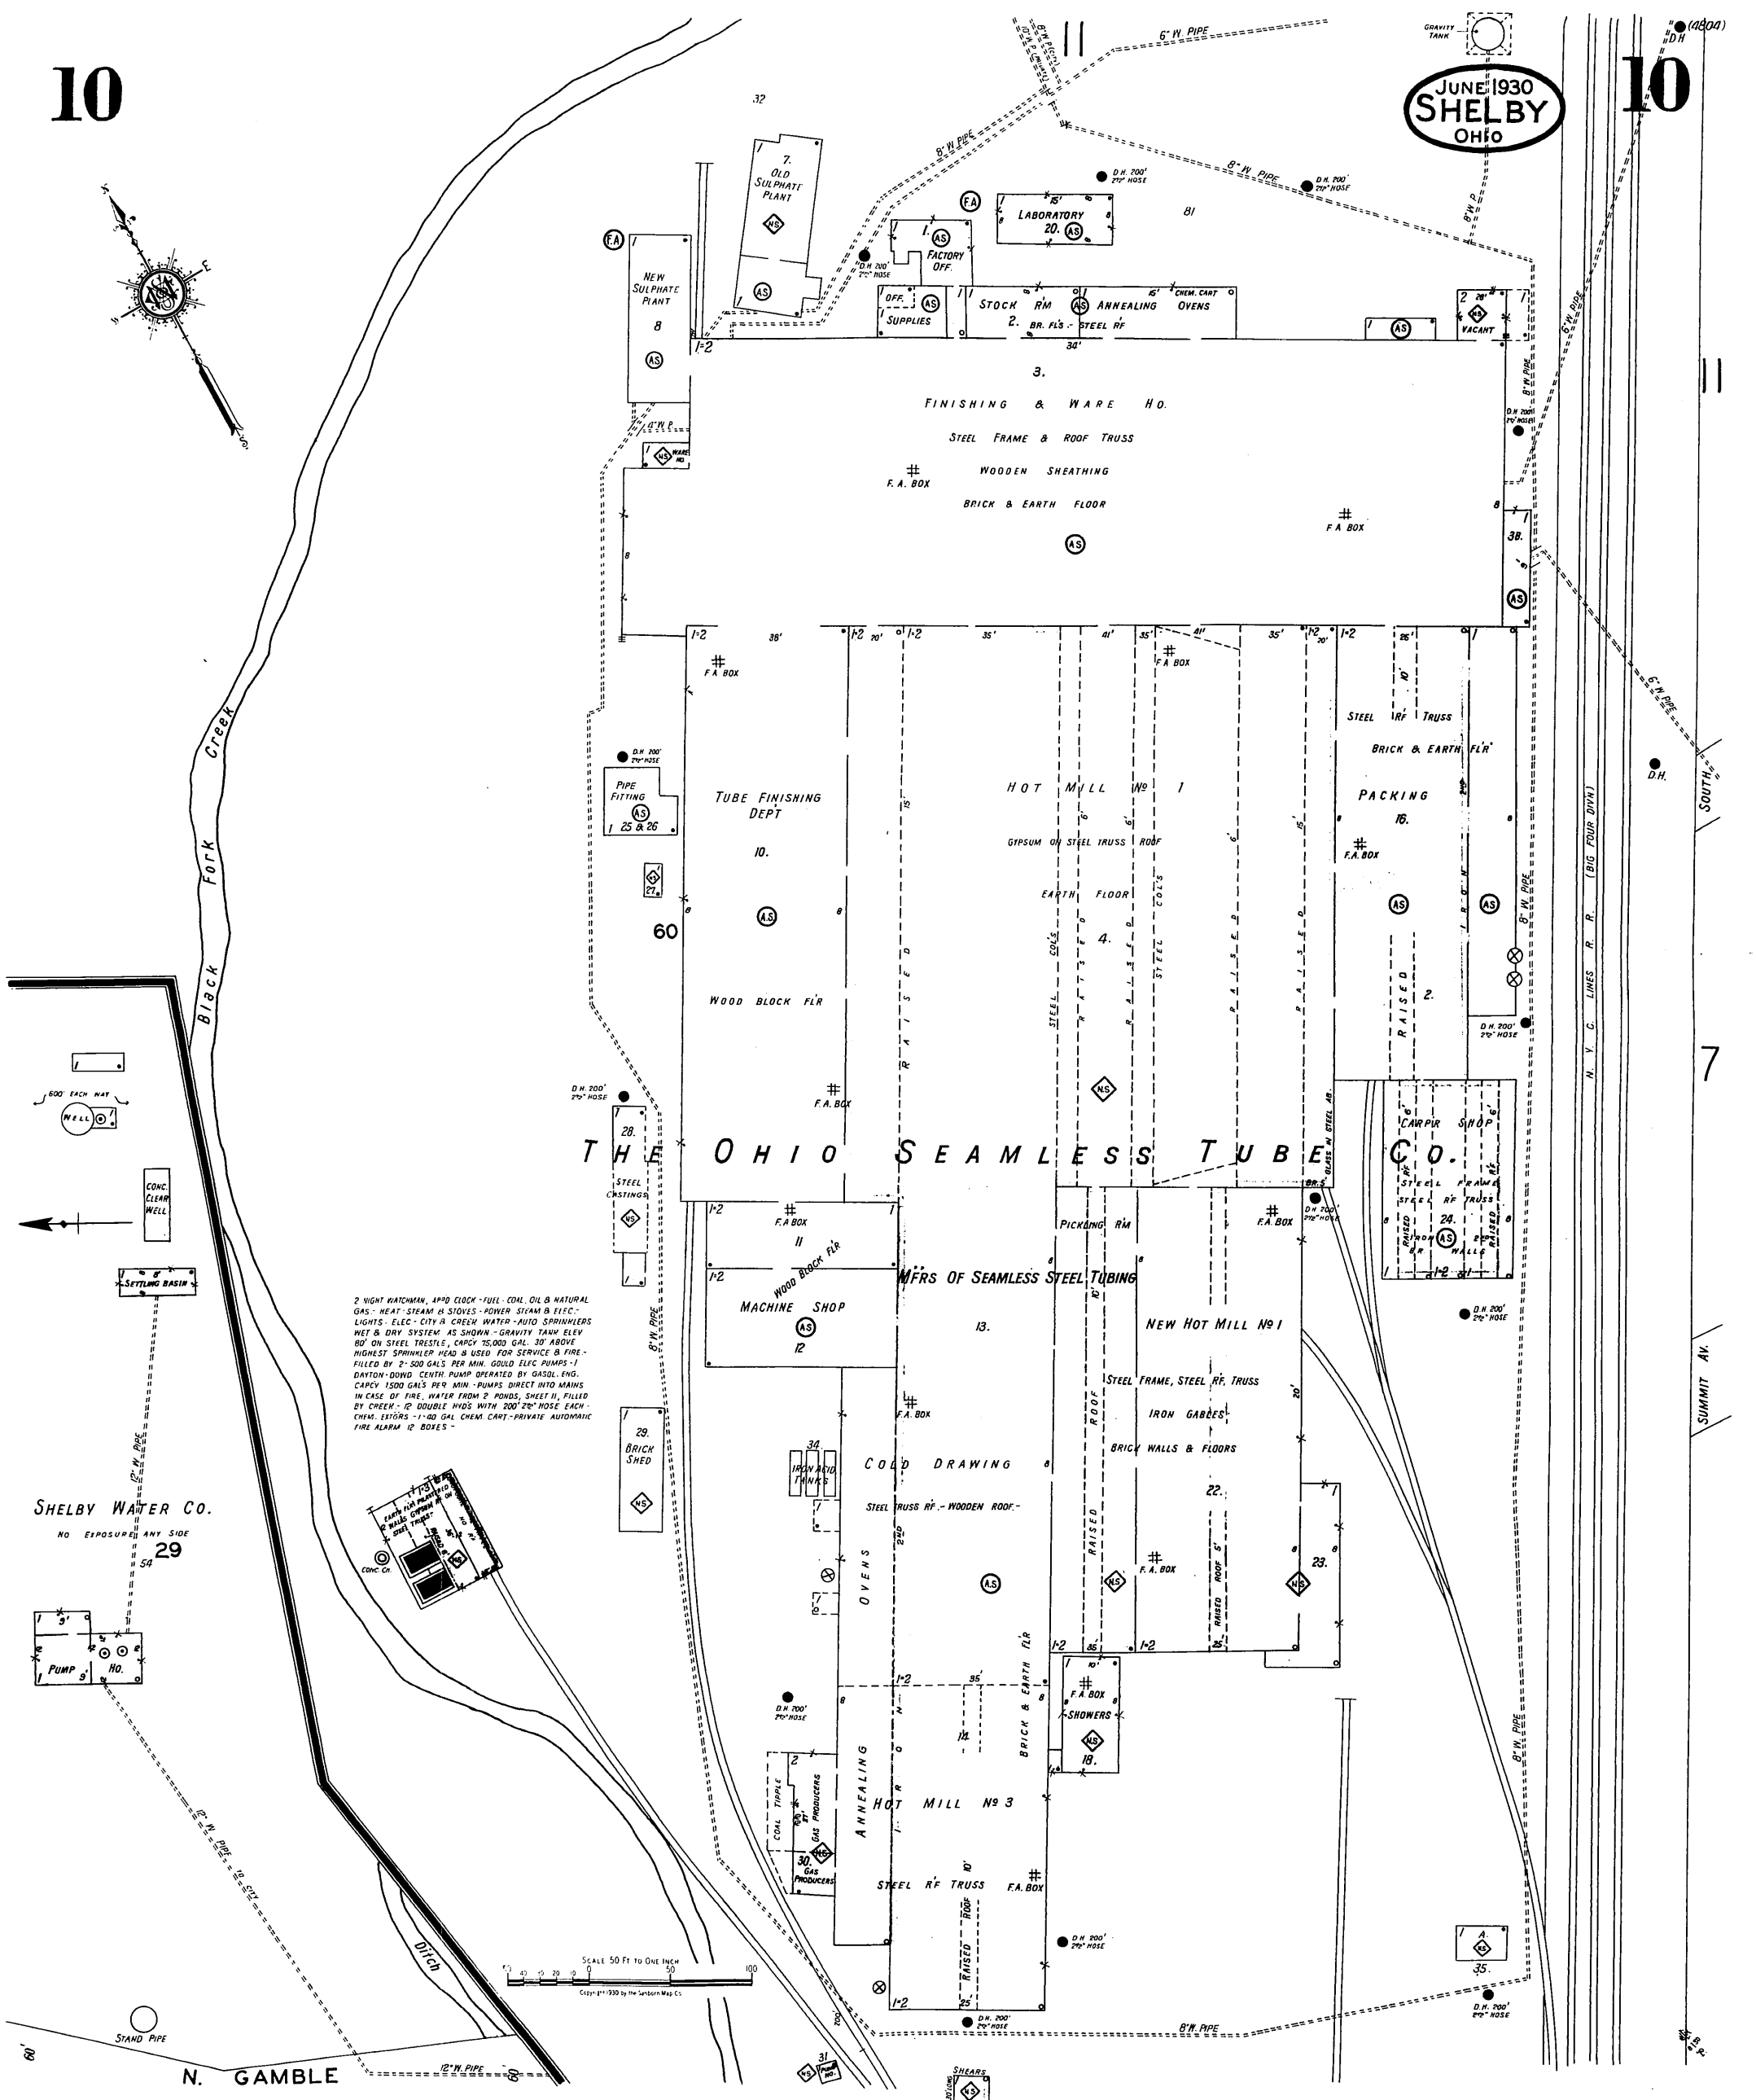

2 NIGHT WATCHMAN, 4 P.M. CLOCK - FUEL - COAL, OIL & NATURAL GAS - HEAT - STEAM & STOVES - POWER - STEAM & ELEC. - LIGHTS - ELEC. - CITY & CREEK WATER - AUTO SPRINKLERS WET & DRY SYSTEM AS SHOWN - GRAVITY TANK ELEV 80' ON STEEL TRESTLE, CAPCY 75,000 GAL. 30' ABOVE HIGHEST SPRINKLER HEAD & USED FOR SERVICE & FIRE - FILLED BY 2-500 GAL'S PER MIN. GOLD ELEC PUMPS - 1 DAYTON-DOWD CENTR. PUMP OPERATED BY GASOL. ENG. CAPCY 1500 GAL'S PER MIN. - PUMPS DIRECT INTO MAINS IN CASE OF FIRE, WATER FROM 2 POUNDS SHEET II, FILLED BY CREEK - 12" DOUBLE INDS WITH 200' 2" HOSE EACH - CHEM. EXTORS - 1-40 GAL CHEM. CART - PRIVATE AUTOMATIC FIRE ALARM 12 BOXES -

SHELBY WATER CO.
NO EXPOSURE ANY SIDE

SCALE 50 FT TO ONE INCH
COPY 1930 BY THE SURVEYING CO.

N. GAMBLE

SUMMIT AK

7