(3 SHEETS)
4963.

1

-NOTE-

FIRE DEPT.: VOLUNTEER, 20 MEN FOR EACH FIRE. ONE HERRING 3d CLASS STEAMER - 2 HOSE REELS - 1000 YDS COTTON HOSE, 500 GOOD RUBBER HOSE, 400 OLD HOSE THAT CAN BE USED. ALL HOSE 2½" OR STANDARD.
WATER WORKS.: WATER DRAWN FROM FOUR O'WELLS - 2 J.H. McGOWAN CO. COMPOUND DUPLEX PUMPS CAP. 1½ MILLION GAL'S IN 24 HOURS. AVERAGE DAILY RUN 8 HOURS. AVERAGE PRESSURE 80 TO 90 LBS. - ABOUT 3½ MILES OF WATER MAINS SIZES 8"-6"-4"- 21 D. HDS., 12 PUBLIC CIST. NOT CONNECTED WITH WATER WKS.
FIRE ALARM: FIRE ENG. HO. BELL & WHISTLE OF PUMP HO.
STREETS: IN GOOD CONDITION, WELL MACADAMIZED
PUBLIC LIGHTS: ELEC.

SANBORN - PERRIS MAP CO., LIMITED
11 Broadway
NEW YORK
Population 1000
1 Steam & No Hand Engines
2 Independent Hose Carts
Water Facilities See Note.
Prevailing Winds W. & S.W.
WAYNESVILLE.
Warren Co. OHIO.
AUG. 1901.
SCALE 50 FT. TO AN INCH.
COPYRIGHT 1901 BY THE SANBORN - PERRIS MAP CO. LIMITED

THE LIBRARY OF CONGRESS
OCT. 28 1901
CLASS
1195

Library of Congress
No. 10438
Maps & Charts

INDEX.

SPECIALS.

	SHEET
B	
Baptist Church	3
Barbeau, J. W., Flour Mill	2
C	
Catholic Church	3
Christian "	3
Commercial Hotel	3
E	
Episcopal Church	1
F	
French Bros., Milk Skimming Station	1
H	
Hammel House	3
Hicksite Friends Church	1
K	
Keys, H. P., Planing Mill	2
M	
Methodist Episcopal Church	3
O	
Orthodox Friends Church	1
P	
Public School	1
S	
Stoops Building	3
W	
Waynesville Water and Light Plant	1
Wright Mill	2

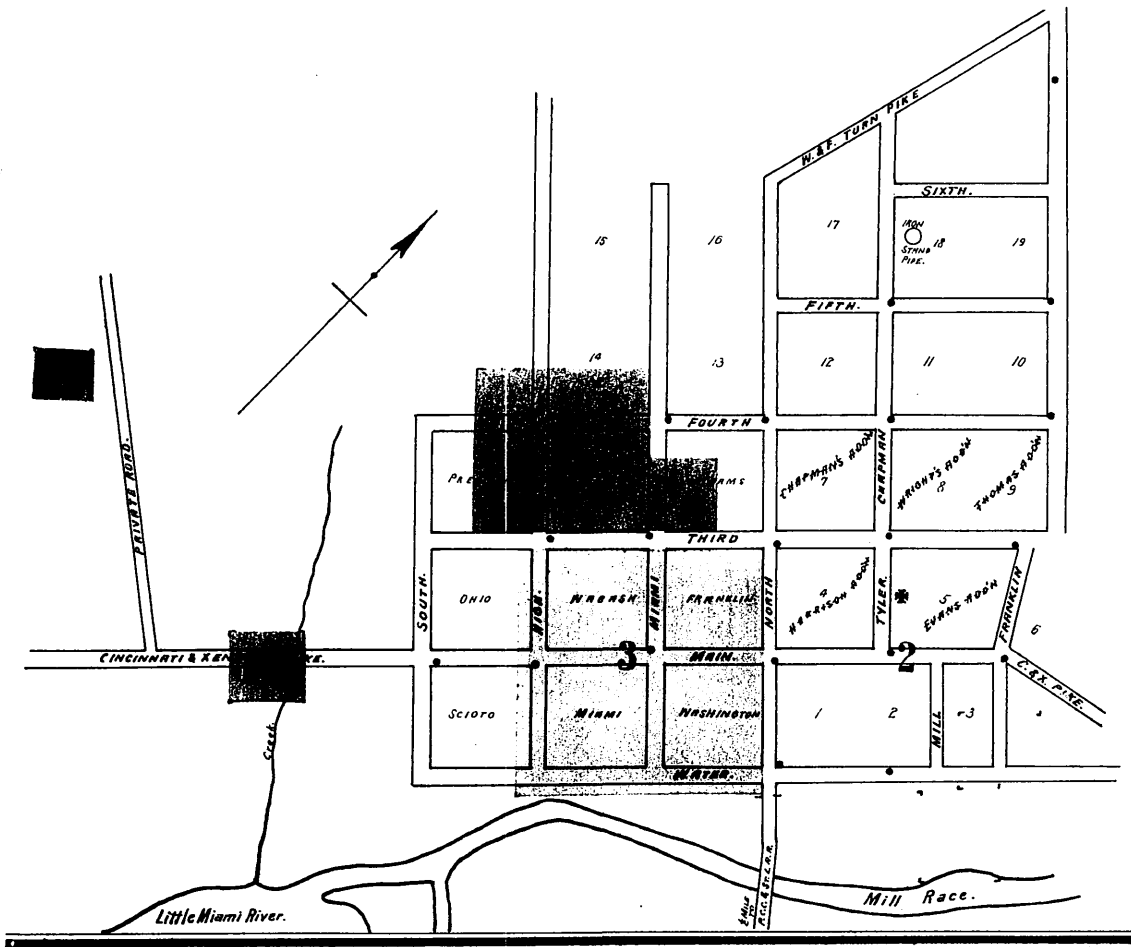

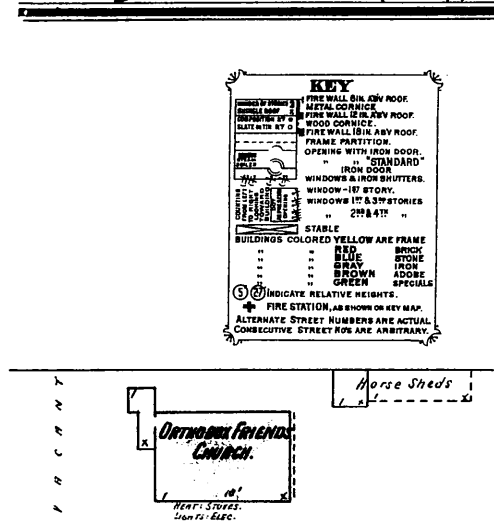

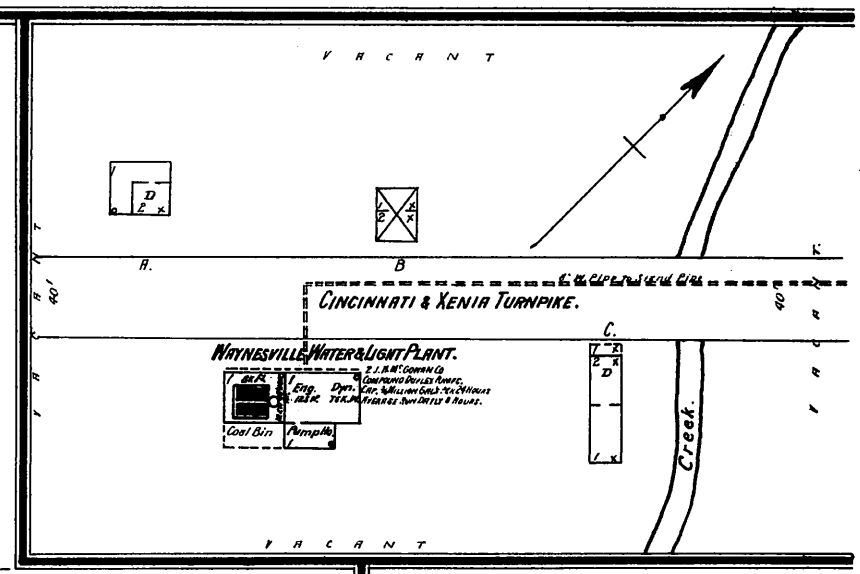

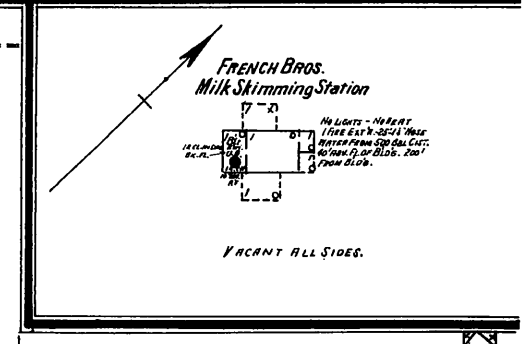

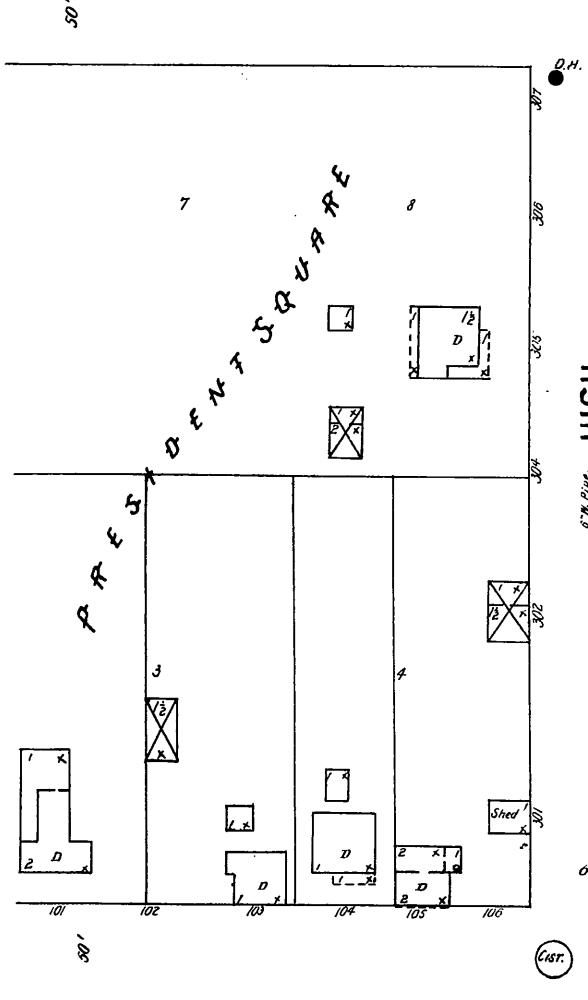

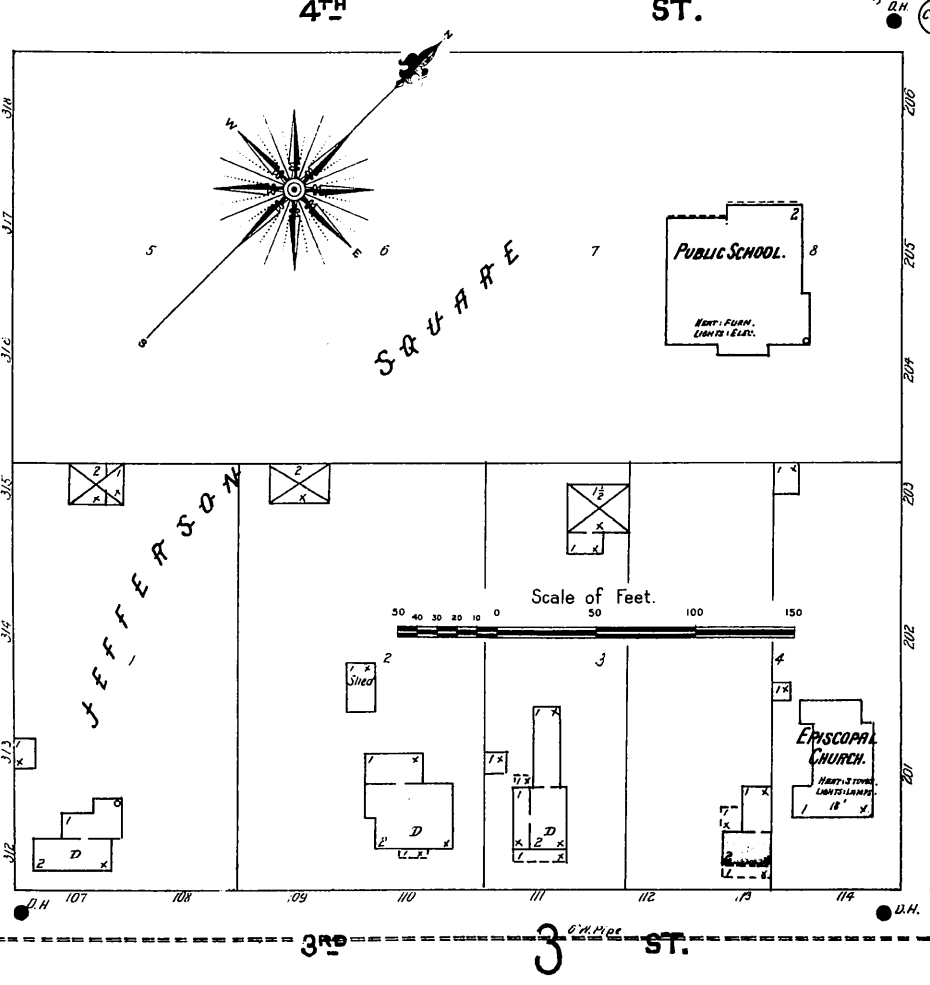

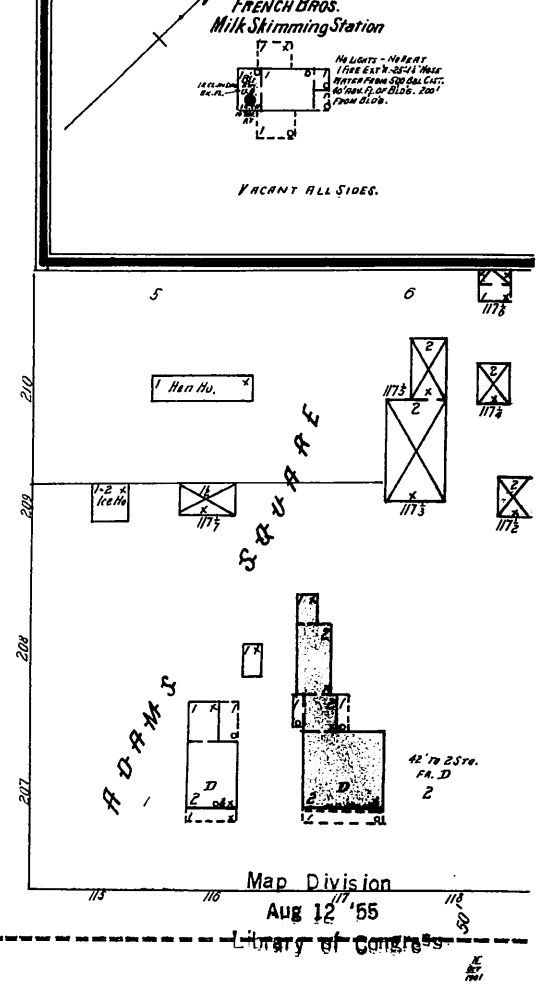

Map Division
Aug 12 '55
Library of Congress